


CUSTOMER OWNED SERVICE AND METER POLE  
APPROVED FOR TEMPORARY SERVICE  
THROUGH CABLE RECEPTACLES ONLY

**GENERAL NOTES:**

1. ALL CONDUIT FITTINGS TO BE RAINTIGHT.
2. SERVICE EQUIPMENT MUST MEET EUSERC REQUIREMENTS AND BE OF PROPER RATING FOR LOAD TO BE SERVED.
3. REQUIRED PERMIT AND INSPECTION MUST BE OBTAINED FROM CITY'S INSPECTION AUTHORITIES BEFORE SERVICE WILL BE CONNECTED BY BWP.
4. WHEN SINGLE PHASE SERVICE LARGER THAN 100 AMPERES IS REQUIRED, OR 3-PHASE SERVICE IS DESIRED, CONSULT BURBANK WATER & POWER AT 818-238-3575.
5. POLE SHALL BE PLACED AT LEAST 6', BUT NOT MORE THAN 75', FROM THE SOURCE.
6. POLE SHALL BE LOCATED SO THAT THE TOPOGRAPHY OF THE LAND, BUILDINGS, OR OTHER OBSTRUCTIONS WILL NOT REDUCE CLEARANCES BELOW THOSE SHOWN HEREON.
7. APPLY FOR SERVICE AT 164 W. MAGNOLIA BLVD. FOR FURTHER INFORMATION PHONE 818-238-3575.
8. AID-IN-CONSTRUCTION CHARGES MAY APPLY AS LISTED IN BWP RULES & REGULATIONS SECTION 3.25. CONTACT BWP SERVICE REP AT 818-238-3575 FOR DETAILS.

MINIMUM CONDUIT COVER 24" ON PRIVATE PROPERTY AND 36" IN PUBLIC RIGHT OF WAY

3" RIGID CONDUIT TO BE INSTALLED FROM SOURCE AS SHOWN ON METER SPOT TO THE METER

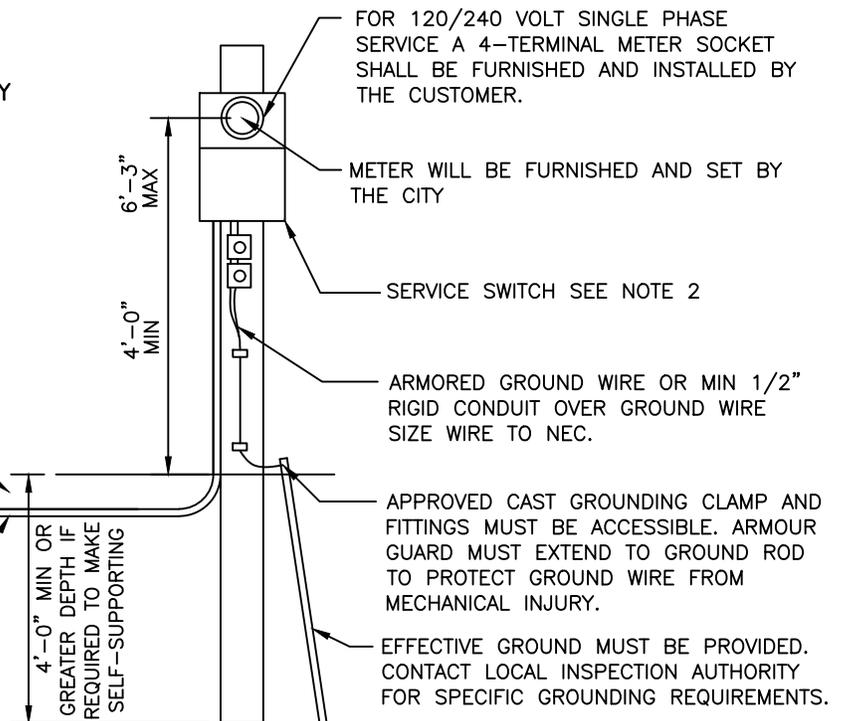

					 <b>WATER AND POWER</b>
A	NEW DRAWING	MEP	CJC	5/9/23	
No.	REVISIONS	BY	APPR'V'D	DATE	

<b>BURBANK WATER AND POWER – ELECTRIC SERVICES</b>	
TEMPORARY UNDERGROUND ELECTRICAL SERVICE REQUIREMENTS	DRAWING No. <b>S-827A</b>
	Sheet 1 of 1